



: i bWjcb'8 YgWjdljcb.'

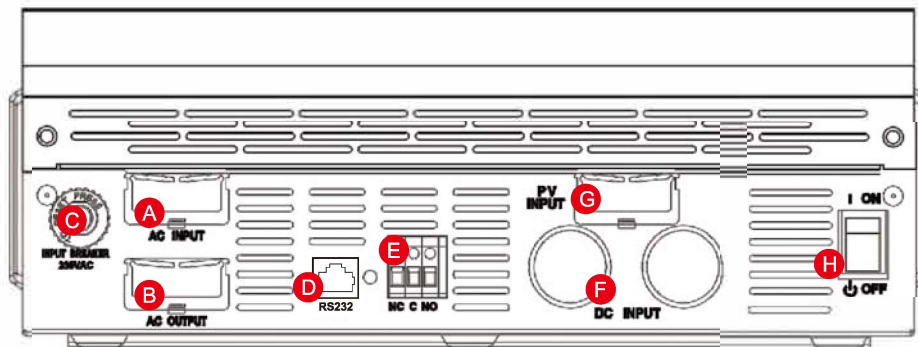

USPP3118C 2-3KVA

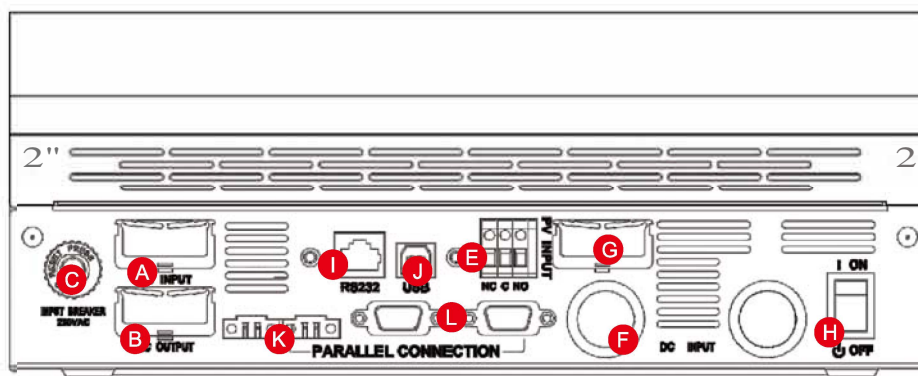

USPP3118C Á ĩ SXOÁ

2" _____

B _____

C _____

I _____

g" _____

I " _____

g" _____

6F _____


"Á _____

: " _____

Q _____

CI _____

Parallel operation with up to 6 units only available for 4KVA/5KVA



Input

Input

Input

AC Load



Built-in MPPT

Wall Mounted



USPP' %/ 7 6

K U' Aci bHX' bHY[fUYX' Gc' Uf' Dck Yf' b; YfHY' hW b]WU' gdYVZ]WUjcb'
 6 i]H]b' ADDH' Gc' Uf' Vb' bfc'' Yf'

MODEL	USPP3118C6
Rated Power	5KVA/4000W

-BDI H	
J c'WU[Y'	& \$J 57'
GYVWU'Y' J c'WU[Y' F Ub[Y'	%-\$!&, \$' J 57' fl cf' DYfgcbU' 7 ca di H'fgk' -\$!&, \$' J 57' fl cf' <ca Y' 5dd']UbWgk'
: fYei YbVWfH' Ub[Y')\$' <n# \$' <n'
CI HDI H	
57' J c'WU[Y' F Y[i' U]cb' f6UH' A cXYk'	& \$J 57-')i'
Gi f[Y' Dck Yf'	%\$\$\$J 5'
9Z]WVbVWfH'DYU'k'	- 'i'
HfUbgZ'fH]a Y'	%\$ a g' fl cf' DYfgcbU' 7 ca di H'fgk' &\$ a g' fl cf' <ca Y' 5dd']UbWgk'
K Uj YZ'fa'	Di f' g]bY' k Uj Y'
65H9FM	
6UH'fmJ c'WU[Y'	(, J 87'
: 'cU]b[' 7\Uf[Y' J c'WU[Y') (J 87'
Cj YfWUf[Y' DfcYVWjcb'	* & J 87'
GC @ F' 7 < 5F; 9F' / 57' 7 < 5F; 9F'	
A U]a i a' DJ' 5ffUmDck Yf'	(\$\$\$K'
A DDH' F Ub[Y' 4' CdYfU]b[J c'WU[Y'	* \$!%%) J 87'
A U]a i a' DJ' 5ffUmCdYb' 7]W]hJ c'WU[Y'	%(J 87'
A U]a i a' Gc' Uf' 7\Uf[Y' 7i fFybH'	6C5
A U]a i a' 57' 7\Uf[Y' 7i fFybH'	* \$5'
A U]a i a' 7\Uf[Y' 7i fFybH'	%(\$5'
A U]a i a' 9Z]WVbVWfH'	- , i'
GHUbXVmDck Yf' 7cbgi a dh]cb'	&K'
D<MG-7 5 @	
8]a Ybg]cbz 81' K' 1' < f]a a k'	&-) L' %(\$ L') (\$'
B YhK Y[\h fl] gk'	% ")'
CD9F5HB; '9BJ-FCBA9BH'	
<i a]X]m)i' 'k'-)i' 'F YU] Y' <i a]X]m]Bcb]Vb' bXYbg]b[k'
CdYfU]b['HYa dYfU]h fY'	\$^7 k')) ^7'
GkcfU[Y' HYa dYfU]h fY'	!%) ^7 k' *\$^7'

GH5B85F 8: gUZ]m' -97 * \$-) \$!%#%97 * &\$ (\$!%#%5G * &\$ (\$!%#%9A 7 / 97 * &\$ (\$!#%5G * &\$ (\$!#%9B) \$-\$ %& 7 @5GG"8Yg] b' UbX'
 H'gh-97 * &\$ (\$! ' #5G * &\$ (\$! ' '
 Bc'Y.DfcXi V]gdYV]WU]cbg' UfY' gi VYVWk' V'WUb[Y' k]h'ci hZ fH' Yf' bch]W''